Distributed Power Setup For One Layout Power District
(District In A Box - Star Network Configuration - PSX)

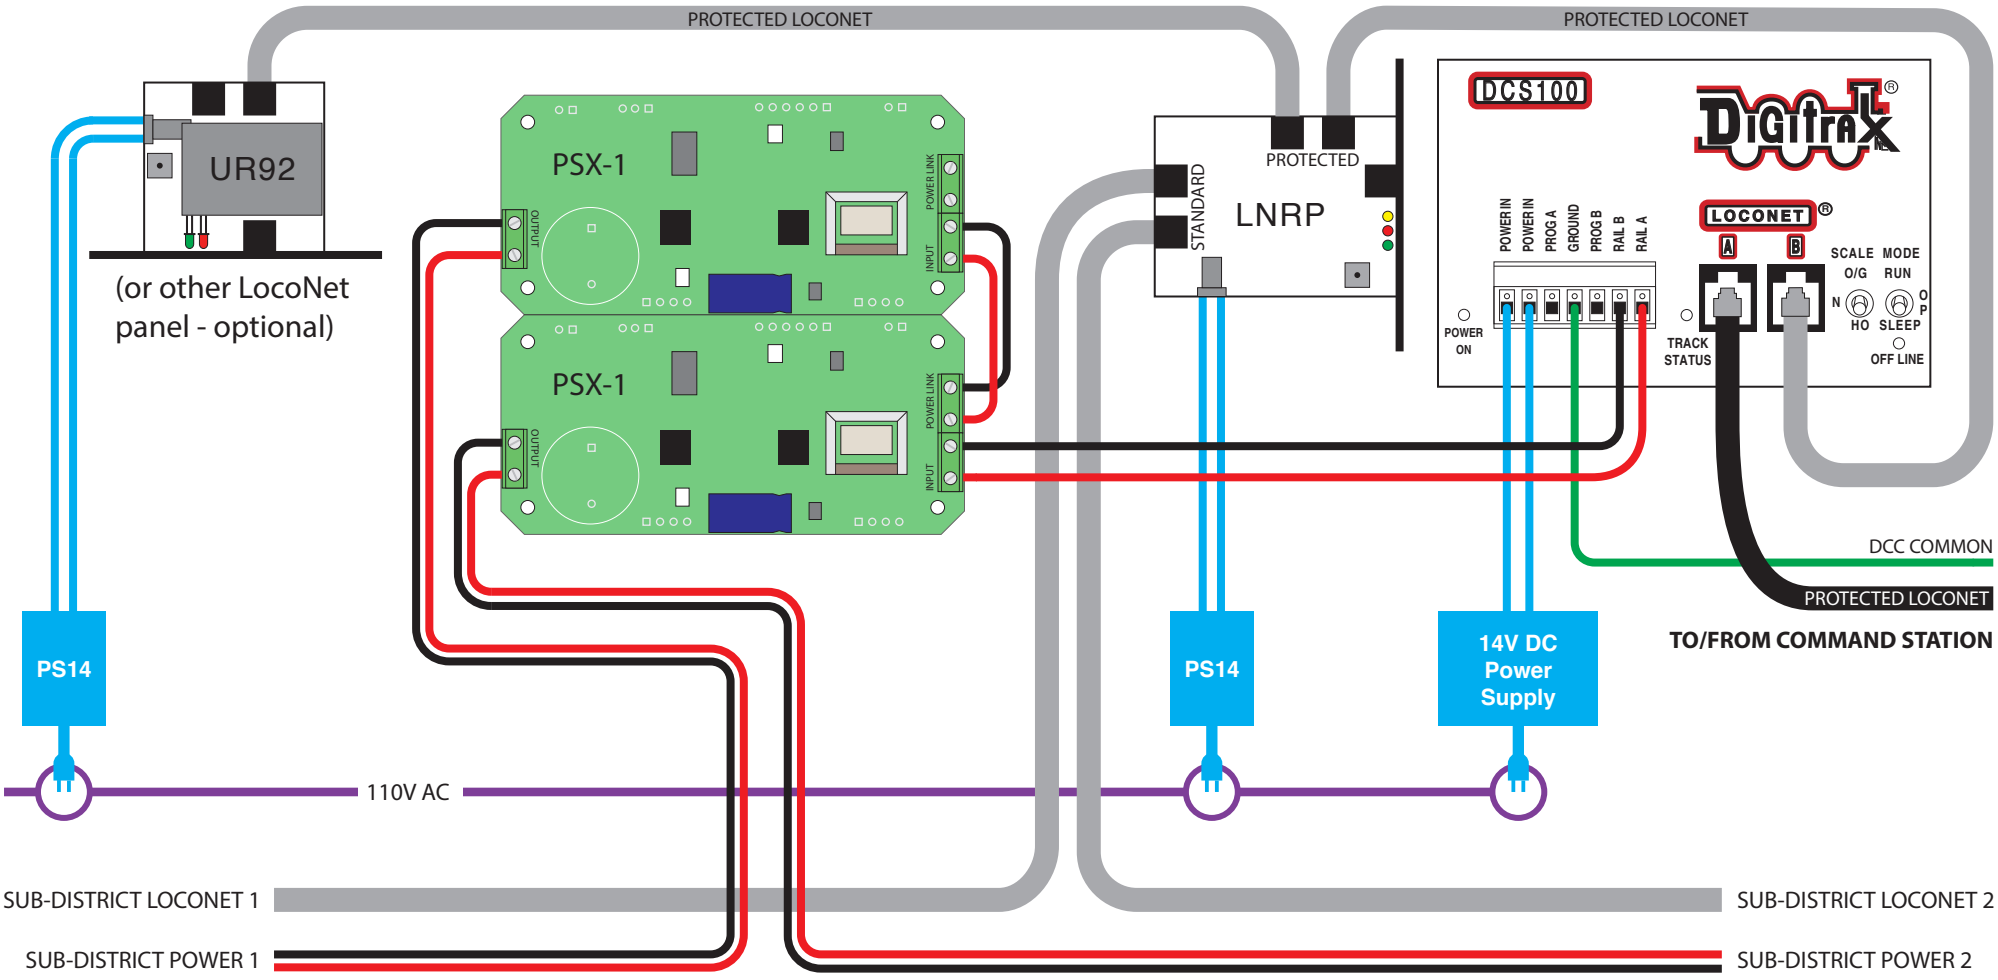

Requires 110V AC, DCC Common connection and one protected LocoNet connection from Command Station.
Recommended length of power district is 60 - 80 feet with booster, LNRP and PSX-1s in the center.
Provides two isolated LocoNet sub-districts and two breaker protected power sub-districts.